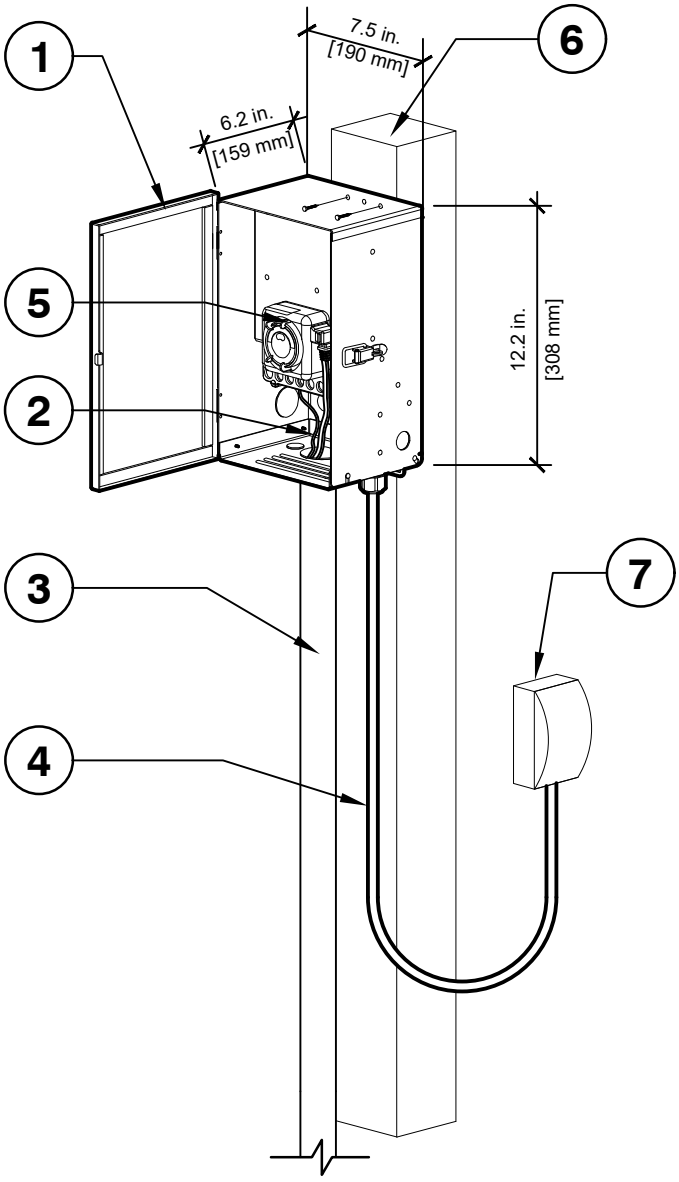


LEGEND:

1. FX LUMINAIRE PX TRANSFORMER
2. LOW-VOLTAGE FIELD WIRES
3. PVC CONDUIT 1.5" Dia. (38 mm Dia.)
4. POWER FEED 120V
5. CONTROL DEVICE
6. POST (4" X 4" MINIMUM)
7. WEATHERPROOF COVER

NOTES:

- ALL METAL PARTS MUST BE GROUNDED IN ACCORDANCE TO NEC GUIDELINES
- BOTTOM OF TRANSFORMER CABINET TO BE A MINIMUM OF 12" ABOVE FINISH GRADE.
- RUN LOW VOLTAGE CABLES IN PVC CONDUIT UNTIL THEY ARE 12" BELOW FINISHED GRADE.
- PROVIDE A MINIMUM 6" DRIP LOOP IN THE CONNECTION TO THE WEATHERPROOF COVERED OUTLET TO PREVENT RAINWATER FROM ENTERING THE OUTLET.

00 FX LUMINAIRE PX TRANSFORMER POST MOUNTNG

NOT TO SCALE